

# AB&Co

## TT BOILERS



Level control  
LAL  
Conductivity measurement (option)

Steam valve  
1" BSP

Safety valve  
1/2" x 3/4"


PAH

TAH

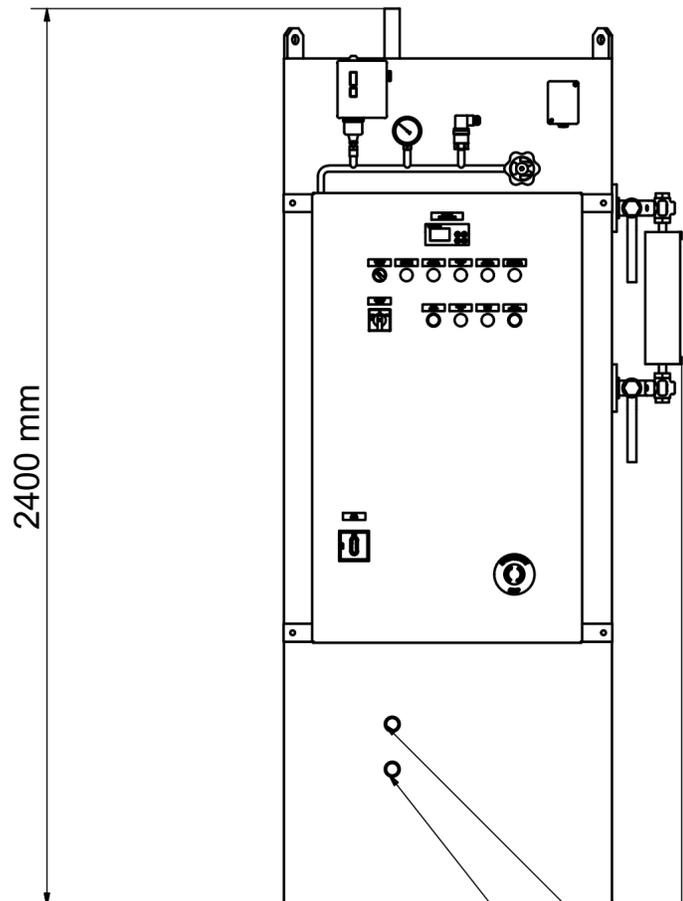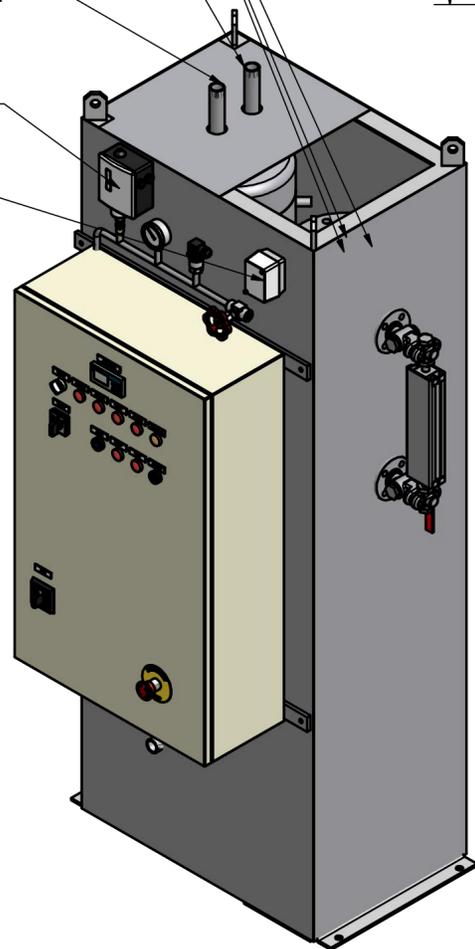

928 mm

2400 mm

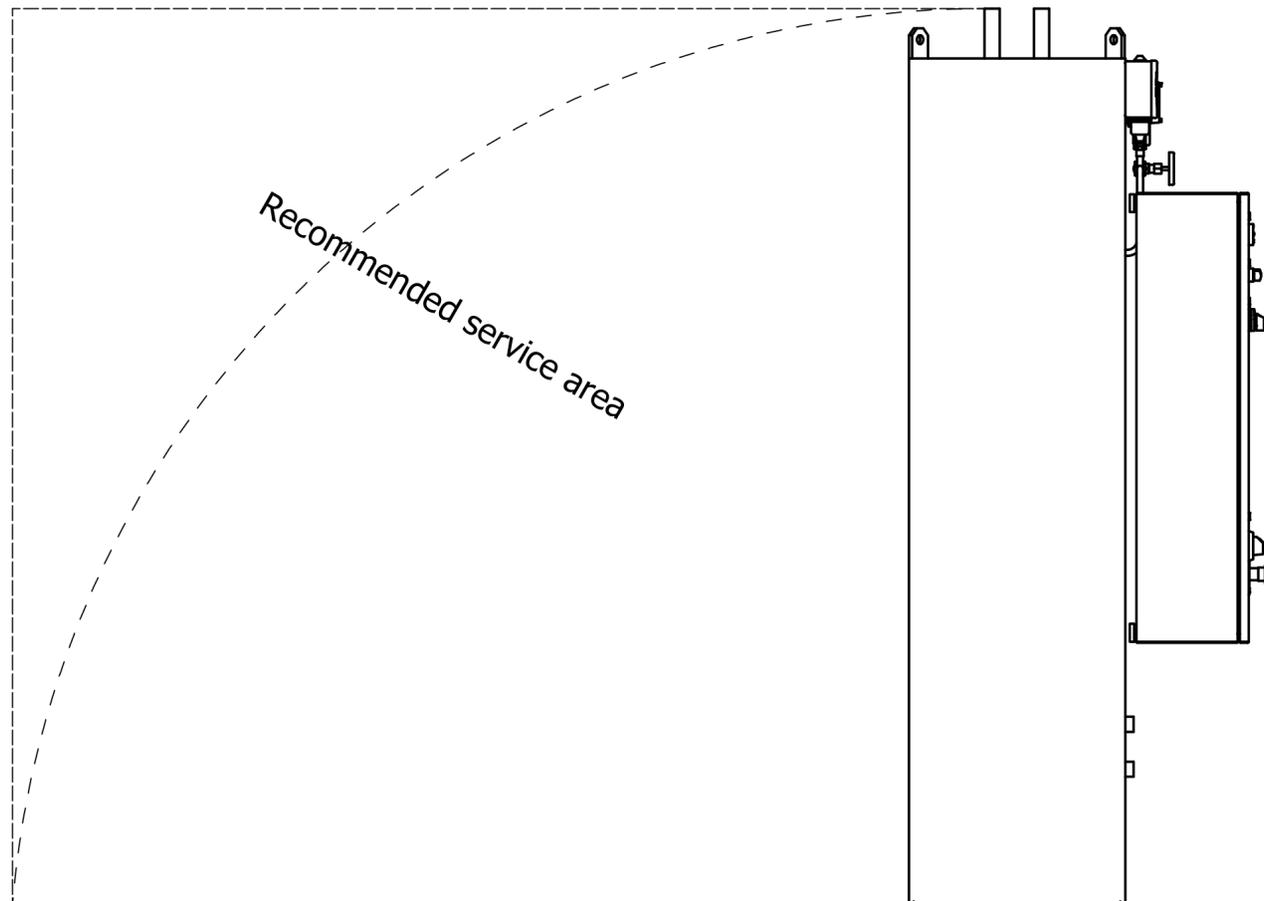

Recommended service area

2400 mm MIN

802 mm

Pump connection 1" BSP

Blow down valve 1" BSP

Heating elements mounted from bottom

**Preliminary sketch  
NOT BINDING**

Designed by KBH	Date 04-06-2013	Checked by	Approved by	Date	Order No.
<b>AB&amp;Co</b> Copenhagen, Denmark			Sheet size A2		
Drawing no. STD_DH-Layout.R0.idw			Approval Drawing no.		

This drawing is the property of AB&Co. It may not be used, copied or handed to any third party or otherwise disposed of without written permission from AB&Co.